
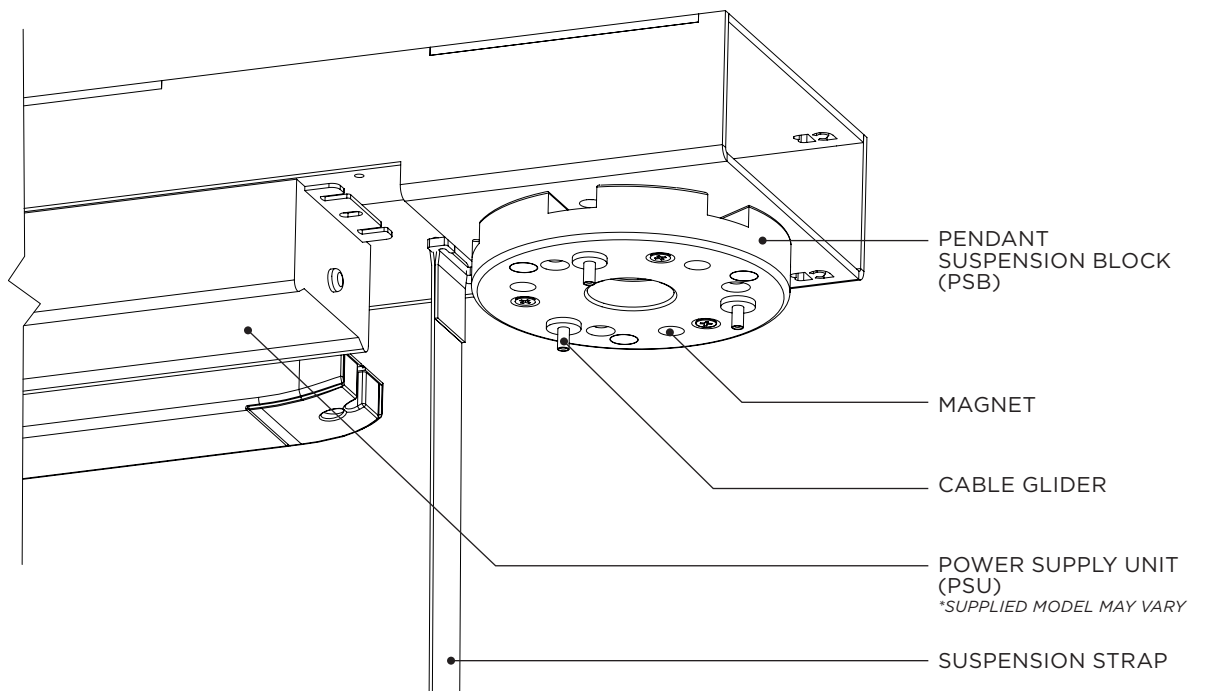


INSTALLATION GUIDE

CANOPY - LINEAR FLUSH

TWIN

LFS.TWIN / LFL.TWIN

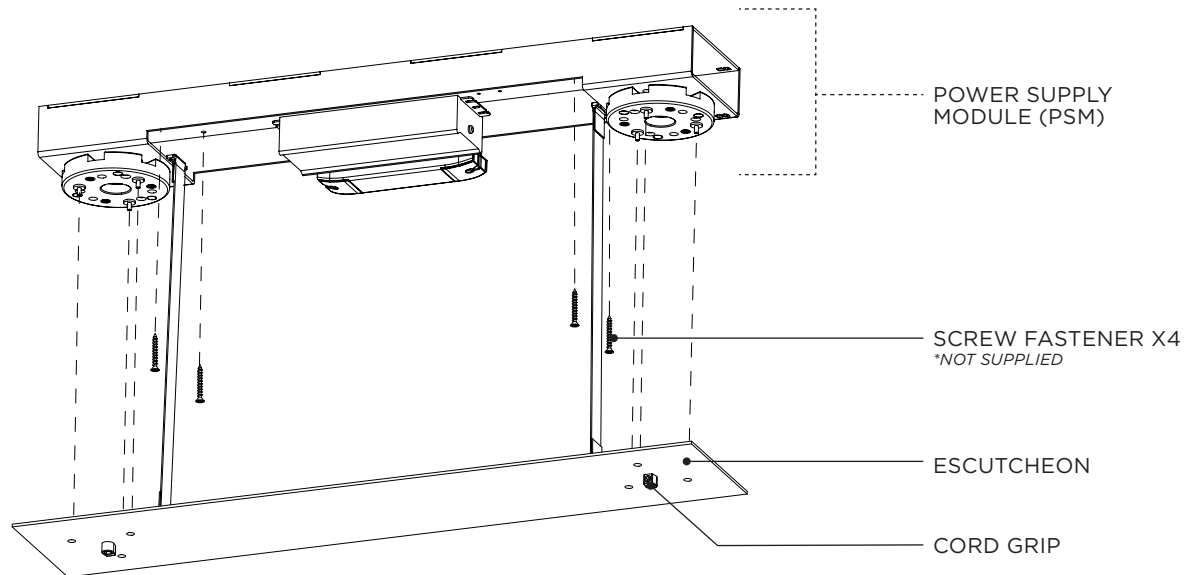

INSTALLATION GUIDE

CANOPY - LINEAR FLUSH

TWIN

LFS.TWIN / LFL.TWIN



WARNING: SHOCK HAZARD

May result in serious injury or death.

ENSURE POWER IS OFF before commencing any work.



WARNING: ELECTRICAL

ALL ELECTRICAL connections must be made by a qualified electrician in accordance with the regulations and codes governing the area for which the CHRISTOPHER BOOTS Fixture is intended to be installed in. Failure to do so may result in serious harm or damage to property and life, at the owner's liability and expense.

CHRISTOPHER BOOTS will not be held liable for any damage caused from installation.



WARNING: STRUCTURAL

Ensure that the substrate is securely installed and is in accordance with local building regulations. Failure to do so may potentially result in serious harm or damage of property, at the owner's liability and expense.

CHRISTOPHER BOOTS will not be held liable for any damage caused from installation.



Refer to supplied WIRING DIAGRAM.


INSTALLATION GUIDE

CANOPY - LINEAR FLUSH

TWIN


LFS.TWIN / LFL.TWIN

- 1 Wearing gloves, unpackage the LINEAR FLUSH CANOPY with care, ensuring not to scratch the surface of the ESCUTCHEON. Separate the ESCUTCHEON from PSM. These are connected via Magnets and can be pulled apart using moderate force.
- 2 Cut a hole in the ceiling for the PSM. The hole should be 130 mm wide, with a length based on the below table.

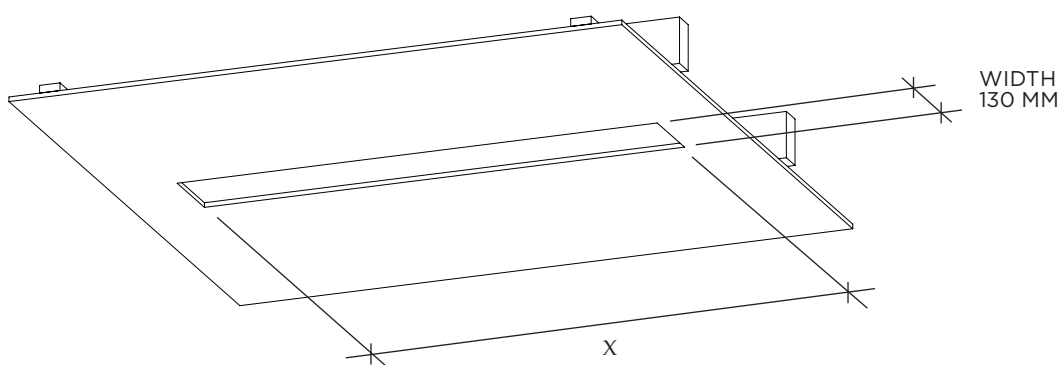

	CODE	DESCRIPTION	CUT LENGTH
X	LFS.TWIN	LINEAR FLUSH SMALL . TWIN	520mm
	LFL.TWIN	LINEAR FLUSH LARGE . TWIN	720mm

- 3 Installer to provide adequate load-bearing substrate, utilising ceiling joists where additional support is required. The mounting face of the substrate must be set back 75mm from the CEILING. For accurate placement of Cable Exits in the Substrate, use the PSM as a guide.

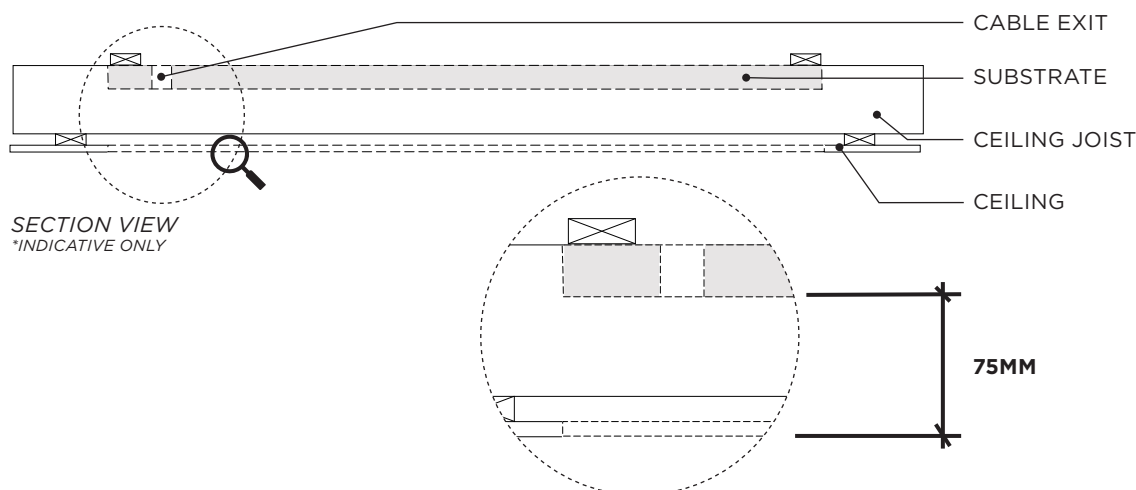


INSTALLATION GUIDE

CANOPY - LINEAR FLUSH


TWIN

LFS.TWIN / LFL.TWIN

- 4** Prepare the 110-240V AC Power to be connected to the PSU.

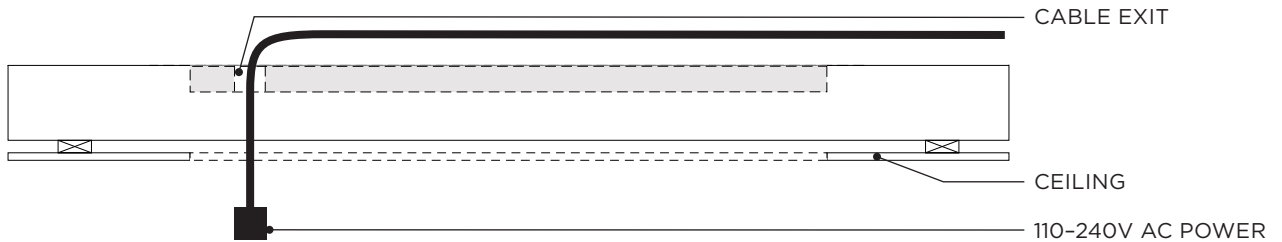

- 5**
- A. Attach the PSM to the prepared Substrate with appropriate Fasteners.
 - B. Ensure the face of the PSB is flush with the CEILING as shown.
 - C. Connect the 110-240V AC Power to the PSU.
Refer to supplied WIRING DIAGRAM →

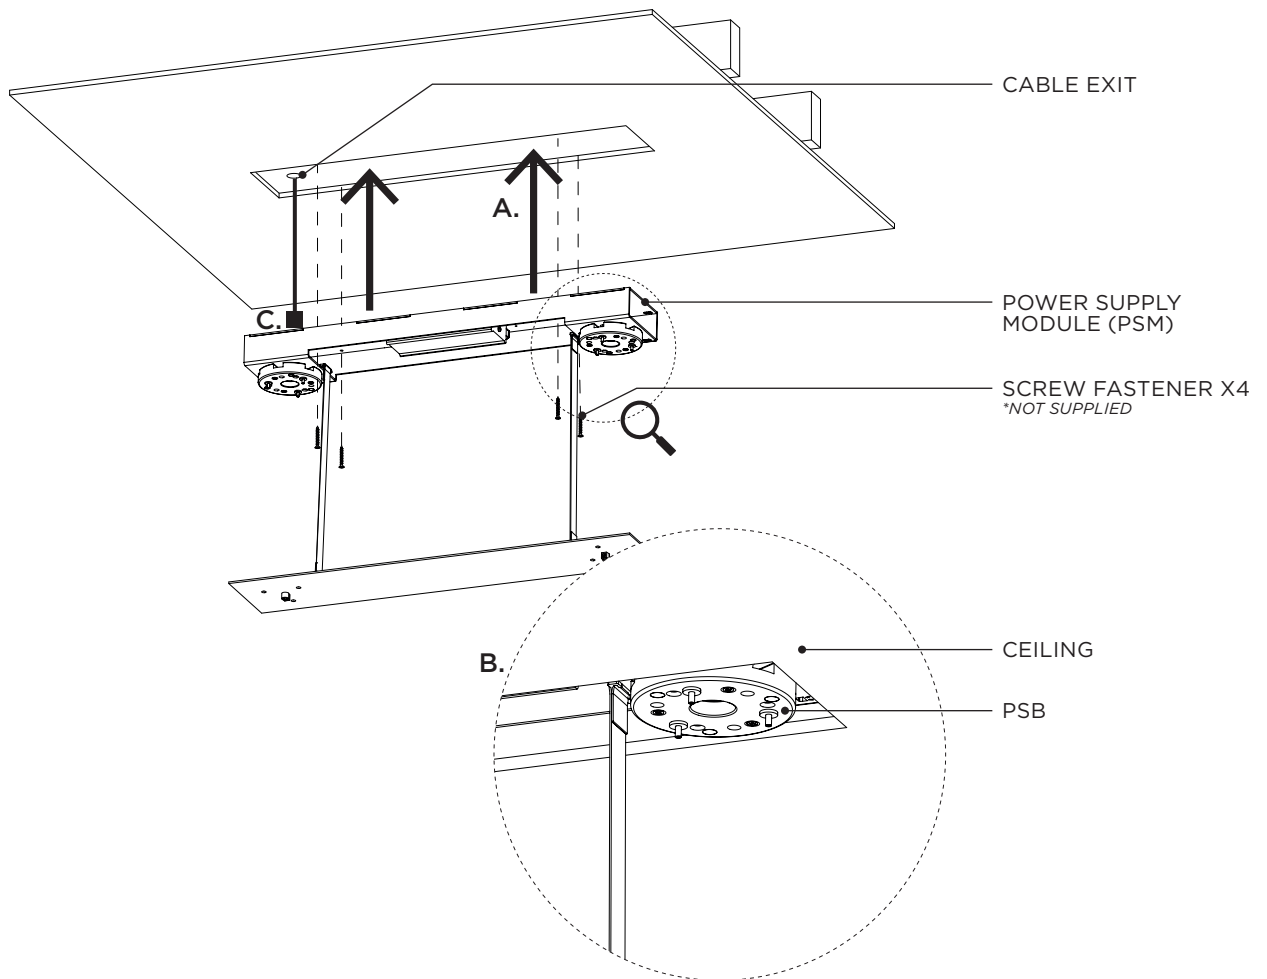


INSTALLATION GUIDE

CANOPY - LINEAR FLUSH


TWIN

LFS.TWIN / LFL.TWIN

- 6** Feed the SUSPENSION WIRES through the holes in the ESCUTCHEON and POWER CABLES through the CORD GRIPS as shown.

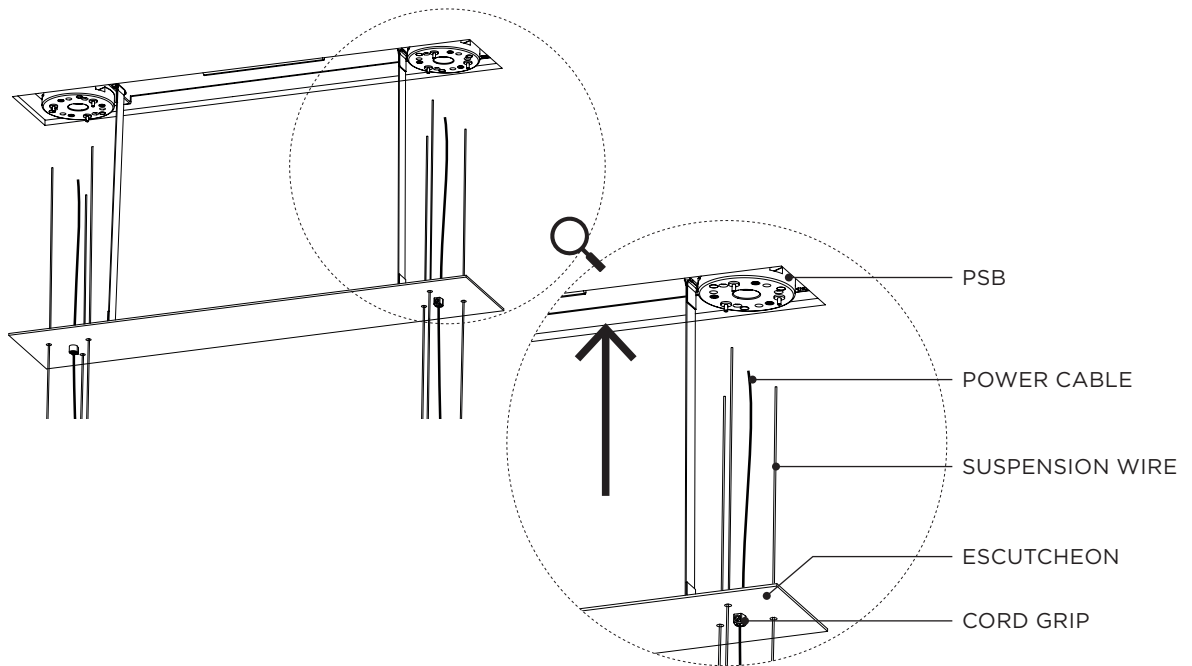

- 7** A. Slightly bend the first 10mm of the SUSPENSION WIRES.
 B. Feed the labelled SUSPENSION WIRES through the corresponding CABLE GLIDERS, and exit through the cavities. Followed by the POWER CABLE through the central hole of the PSB.

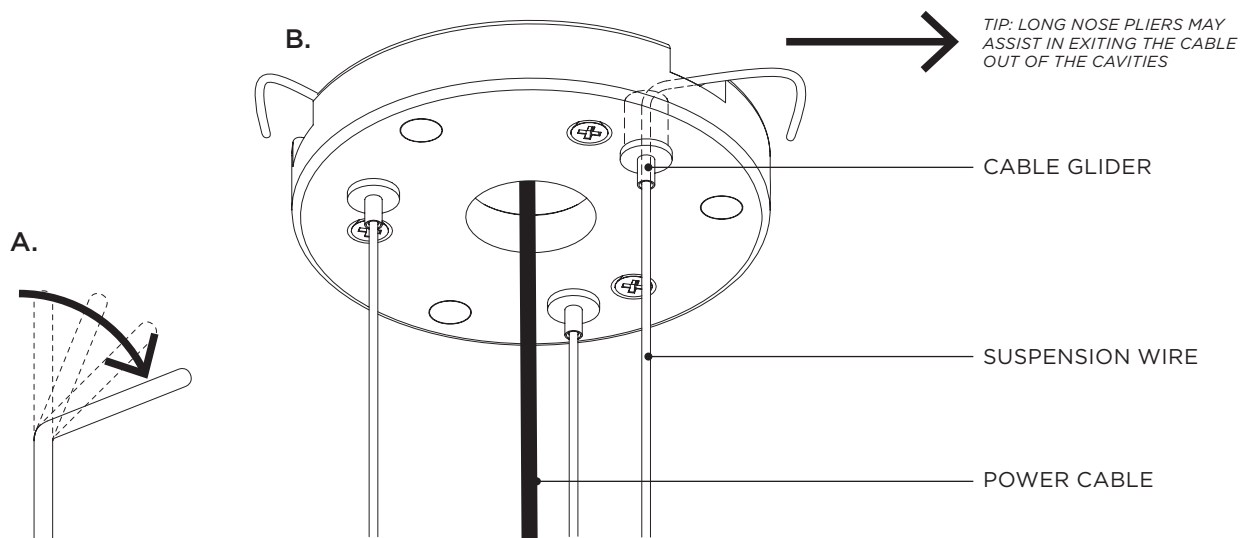


INSTALLATION GUIDE

CANOPY - LINEAR FLUSH

TWIN

LFS.TWIN / LFL.TWIN

- 8**
- A. Raise the PENDANT, feeding excess cable through the CABLE GLIDERS. Set into position by gently lowering the PENDANT.
 - B. While supporting the pendant make necessary adjustments; To lower, press the cable gliders gently allowing excess cable to slide downwards. To raise, gently feed the cables up through the cable gliders. When satisfied with arrangement, ensure that neither the PENDANT or SUSPENSION components are touching.

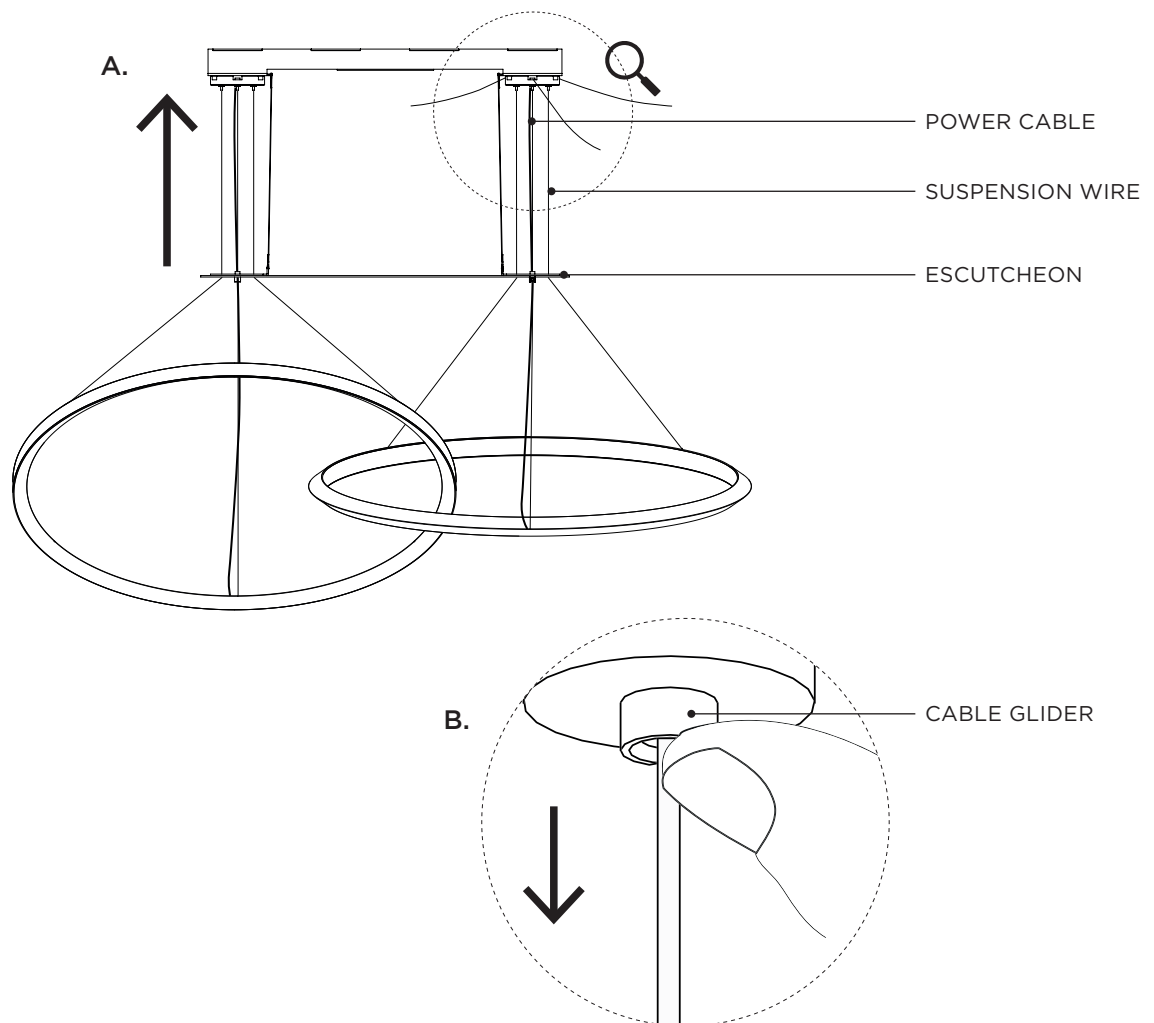

- 9**
- Connect the POWER CABLE from the PENDANT to the PSU.
Refer to supplied WIRING DIAGRAM →

W


INSTALLATION GUIDE

CANOPY - LINEAR FLUSH


TWIN

LFS.TWIN / LFL.TWIN

- 10** Carefully raise ESCUTCHEON to the ceiling and push SUSPENSION STRAPS towards the centre until the Magnets engage. Ensure no contact between ESCUTCHEON and CABLE GLIDERS, as this may release the suspension wires.

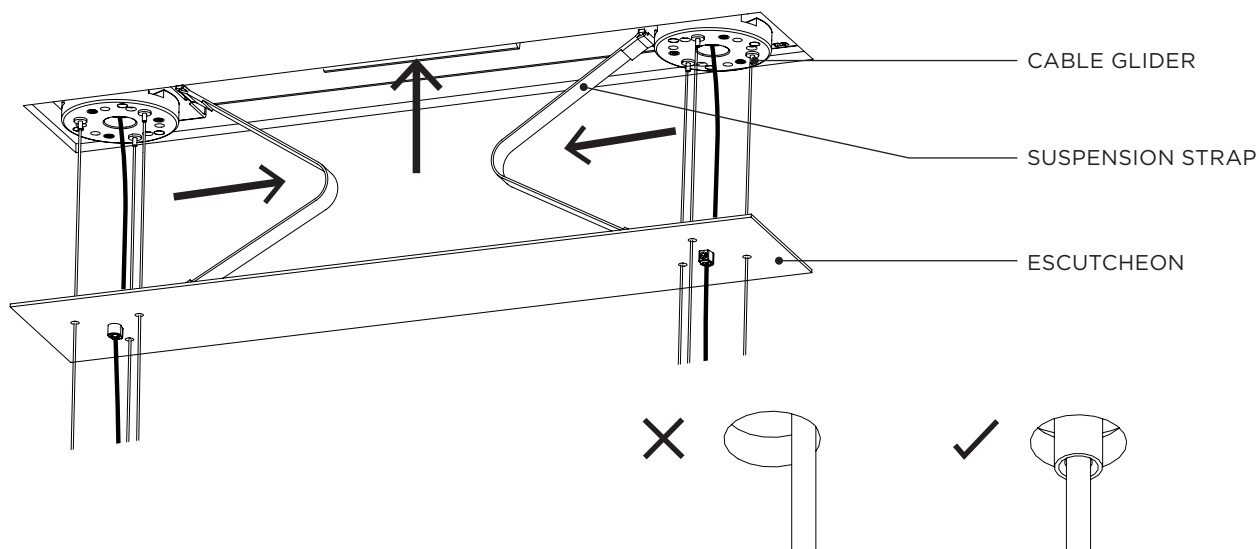

- 11** With the ESCUTCHEON in place, ensure the CORD GRIPS are adequately tightened on to the POWER CABLE and make any necessary final adjustments to the PENDANT.

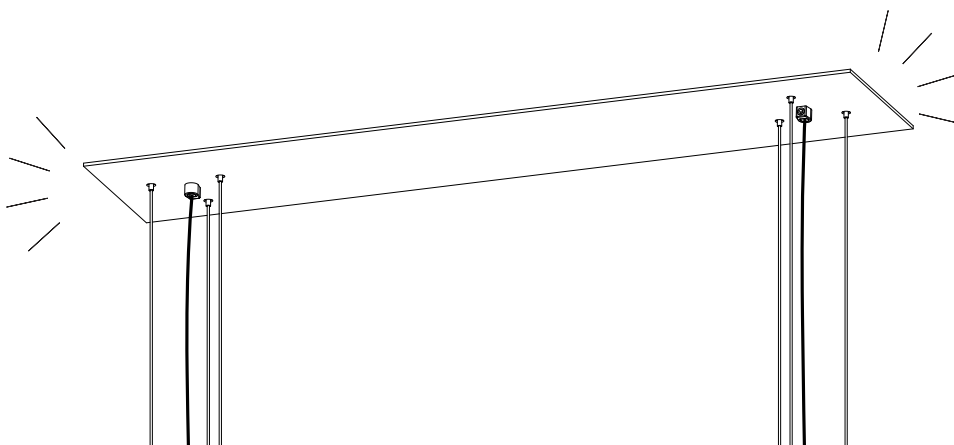


INSTALLATION GUIDE

CANOPY - LINEAR FLUSH

TWIN

LFS.TWIN / LFL.TWIN

- 12 Conduct a final visual assessment of both the canopy and fixture to ensure all parts have been properly fitted and secured. Once satisfied that everything is in working order, remove all remaining protective material which will now complete the installation process.

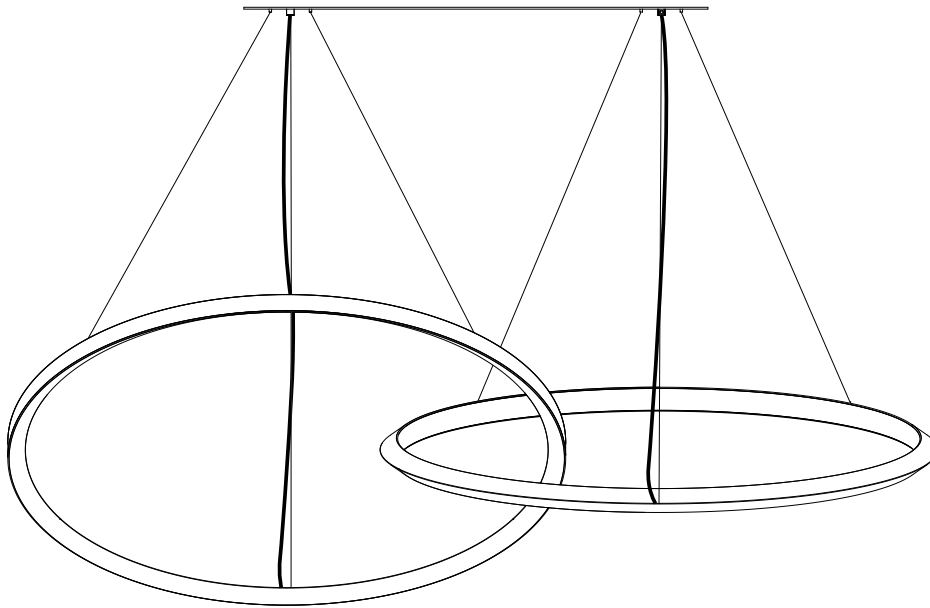

FINISH